

**Northridge Water System Improvement Project**  
**Addendum #3**  
**January 3, 2024**

The following questions were received through January 3, 2023 from interested contractors and suppliers. Responses are in **bold**.

1. Are bid bonds required? **Yes.**
2. Is blasting allowed? **No.**
3. Can the new lines be pressured tested and disinfected at the same time? **Yes**
4. We were at the mandatory pre-bid in May but not in November. Can we still bid on the project? **Yes, the Town waived the mandatory attendance requirement for the November pre-bid meeting for those contractors that attended the May pre-bid meeting.**
5. Is the Town supplying sleeves for the new pipe crossings under County roads? **No, if desired, bidders should include sleeves in their unit prices for road crossing installations. The Town is not requiring sleeves.**
6. If we have to re-seed, what seed mix do we use? **Required seed mix specifications will be provided by the Town depending on the location of re-seeding**
7. Can we add a line item for vac'ing around utilities? Or do we include in L.F. quote and connections quotes? **No, if desired, contractors should include those costs in their unit item costs for pipe installation.**
8. When we tie in the new line to the existing main line, are they going to shut the water off or will we have to do a hot tap? **When practical, water lines will be shut off for up to 8 hours in one day. Bidders should consider including hot tap costs in their unit item cost for connections to the existing system pipes.**

**NOTE: Sheet D-4, showing details for the master meter vault, are included with this addendum and will be made part of the "Issued for Construction" plan set.**



Contractor shall acknowledge receipt of this addendum and include this acknowledgement with their bid to be considered as compliant with the requirements of the Request for Proposal.

\_\_\_\_\_

Printed Name


\_\_\_\_\_

Signature


\_\_\_\_\_

Date

T:\CML\2022\002-CIV Town of Cedaredge -Northridge Water System Improvements\BSCAD\MC-DT-Northridge Water Details.dwg PLOT DATE 2024-1-3 12:45 SAVED DATE 2024-01-03 12:43 USER: sjpckson

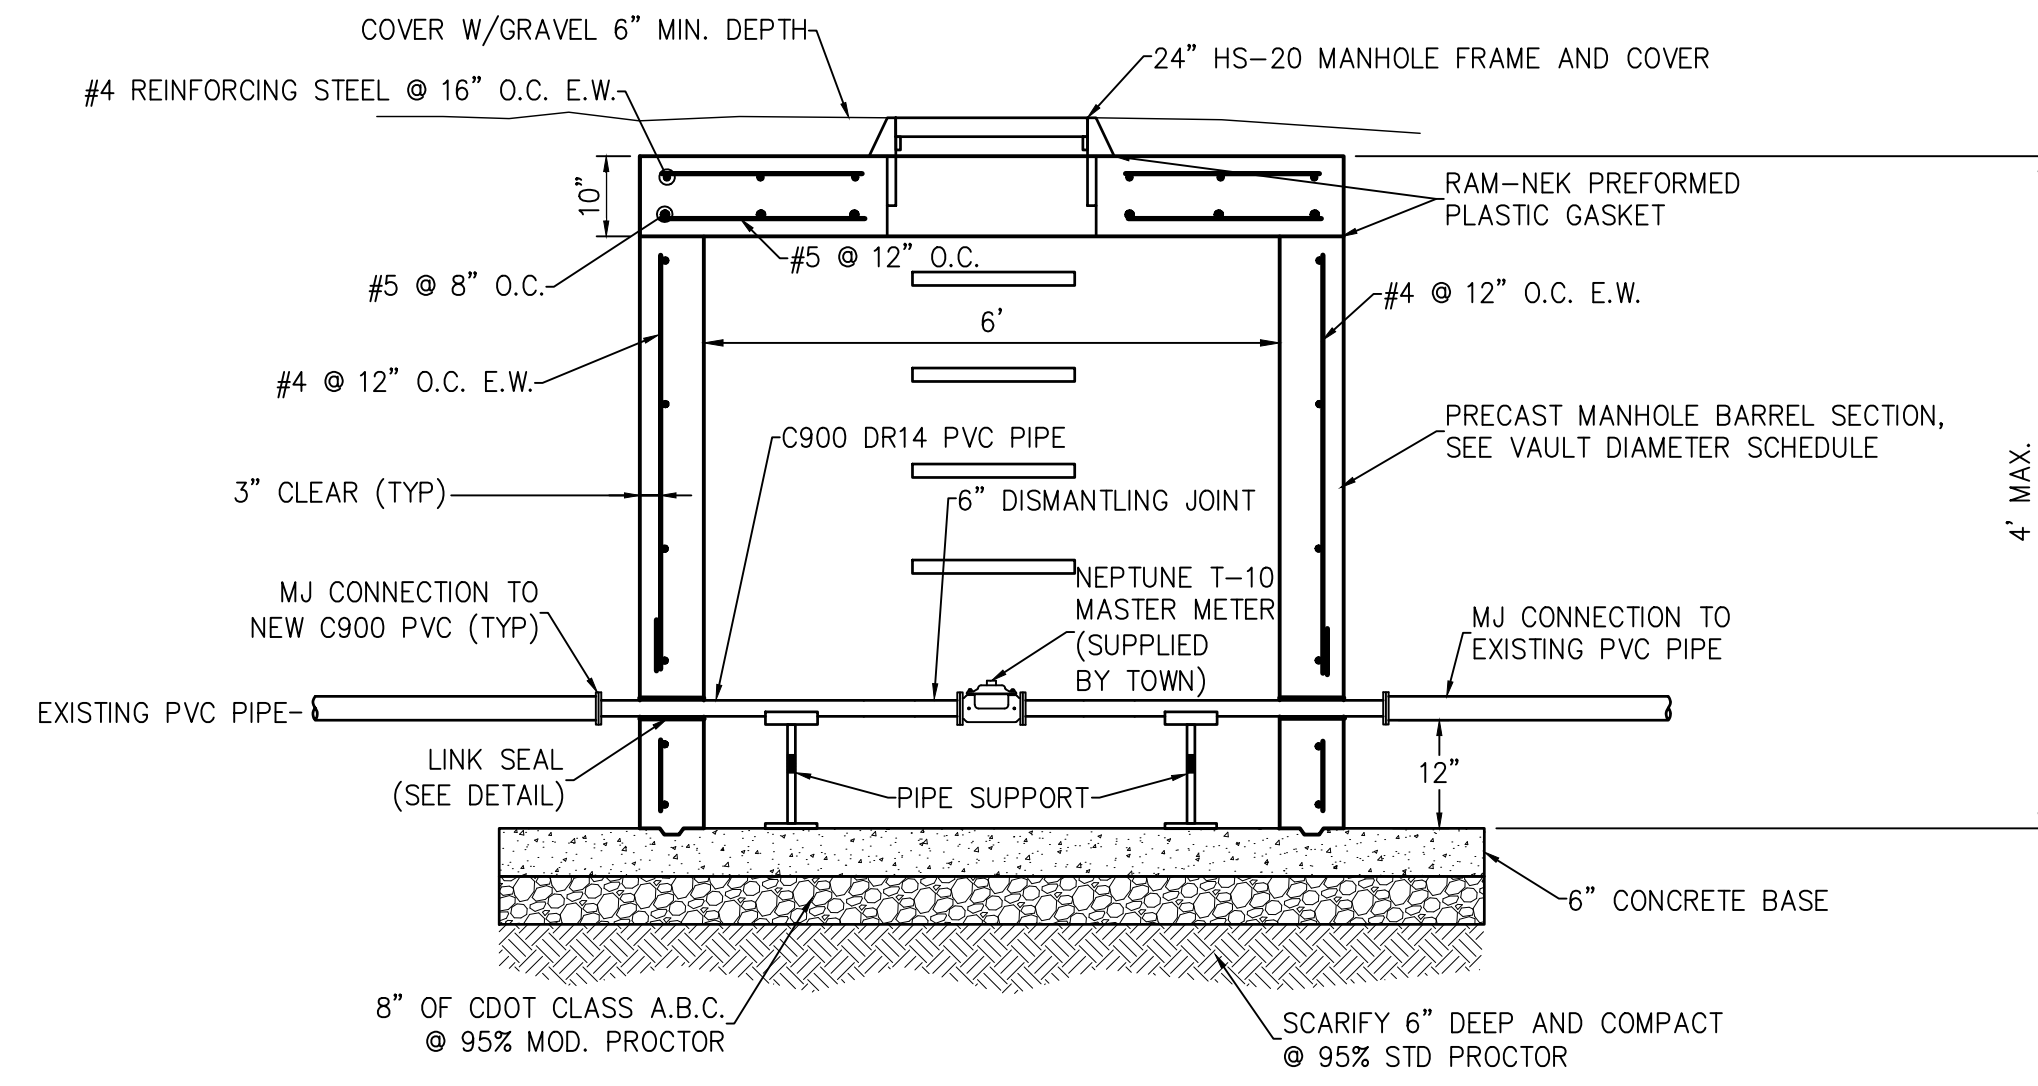


**SECTION A-A**  
NTS

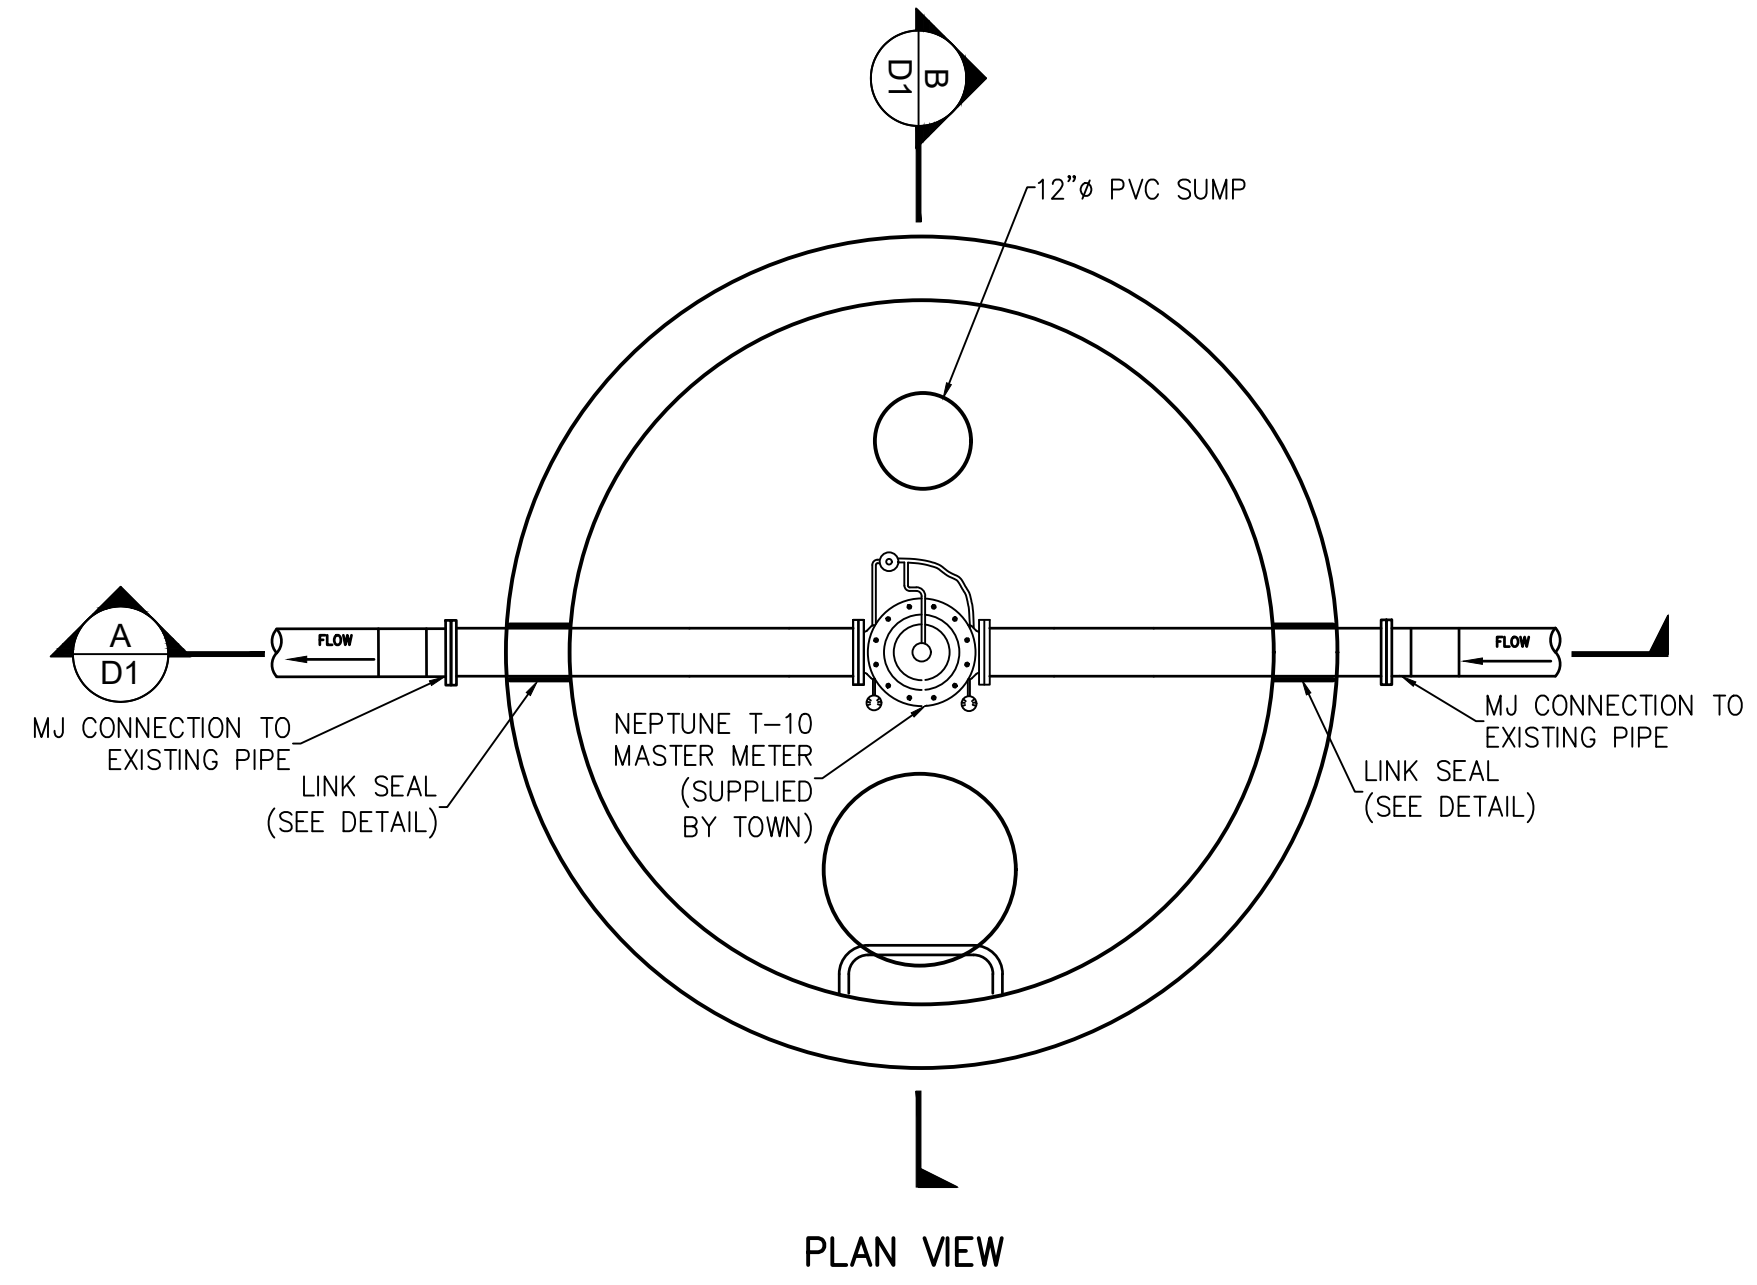


PLAN VIEW

**1**  
D-1 **MASTER METER VAULT DETAIL**  
NTS

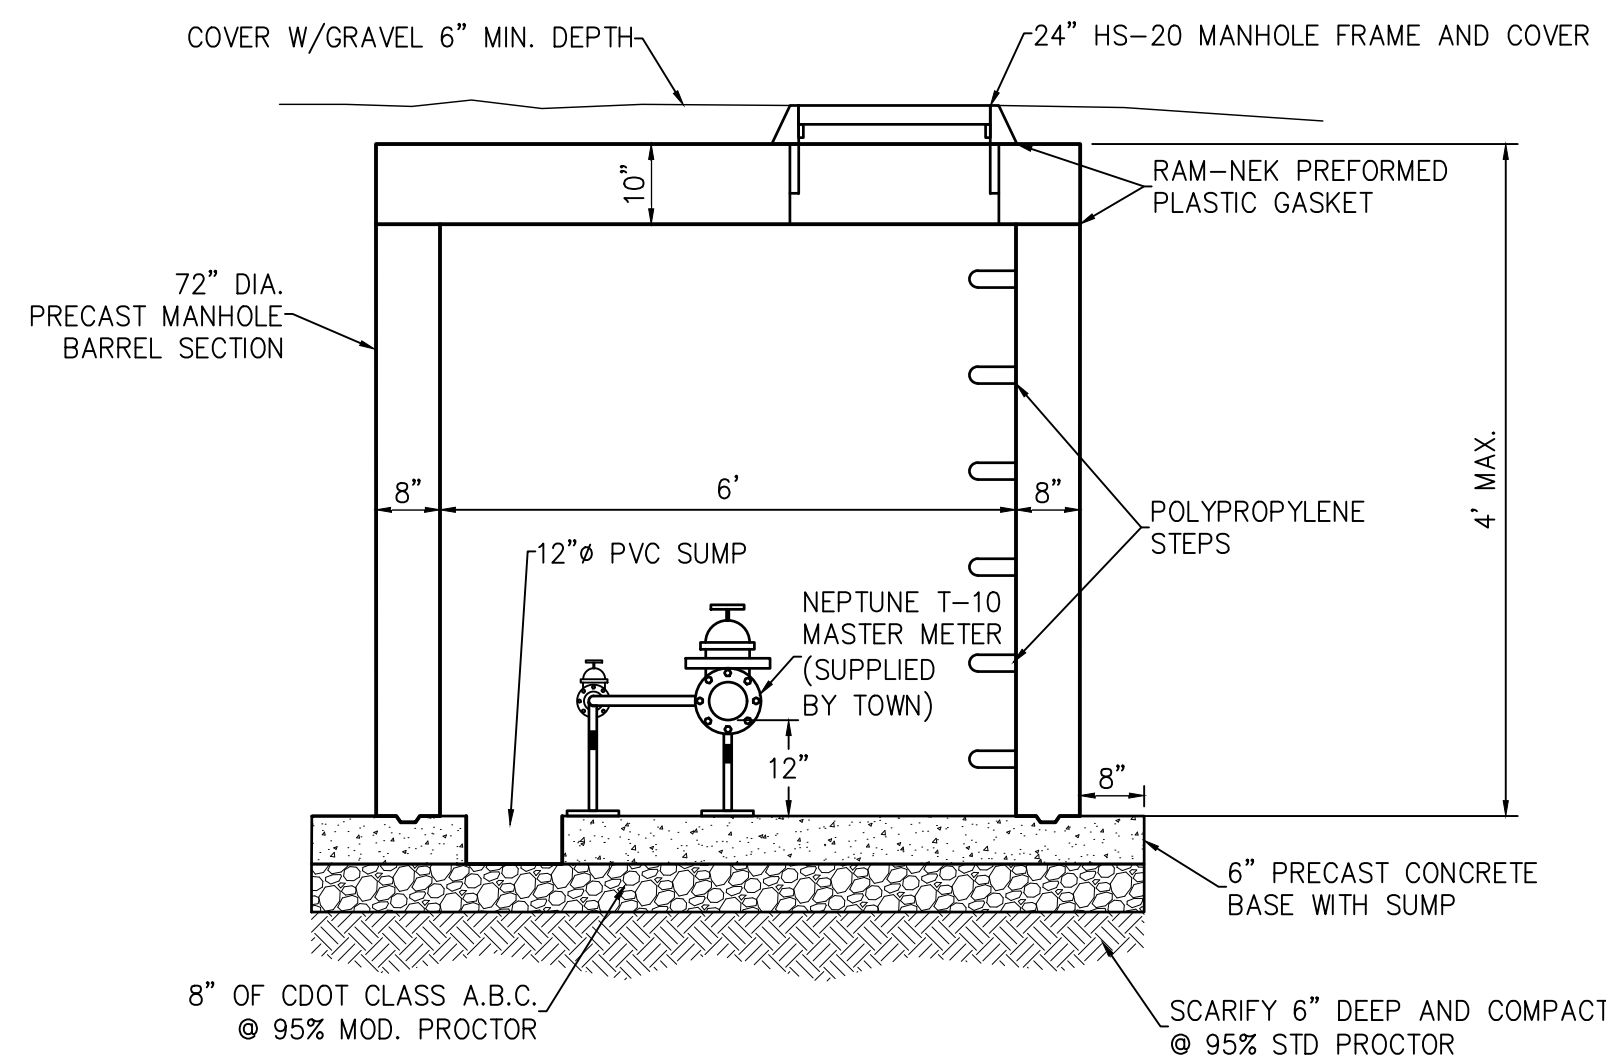

**SECTION B-B**  
NTS

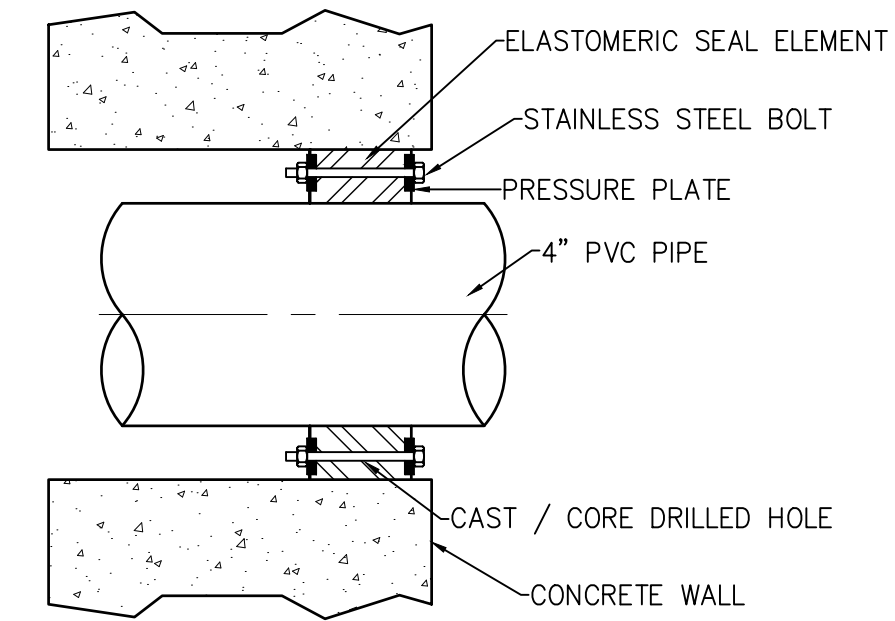

**3**  
D-1 **LINK SEAL DETAIL**  
NTS

REV	DATE	DESCRIPTION	BY

**BUCKHORN**  
**ENGINEERING**  
222 South Park Avenue  
Montrose, Colorado 81401  
970-249-6828

**NORTHRIDGE WATER SYSTEM UPGRADE**  
MASTER METER VAULT DETAILS  
CEDAREDGE, COLORADO

PROJECT	2022-002-CIV
DATE	12/18/2020
DRAFTER	SJ
CHECKED	DQ
BUCKHORN ENGINEERING	

SHEET  
**D-4**  
SHEET 15 OF 15



**ISSUED FOR BID**